



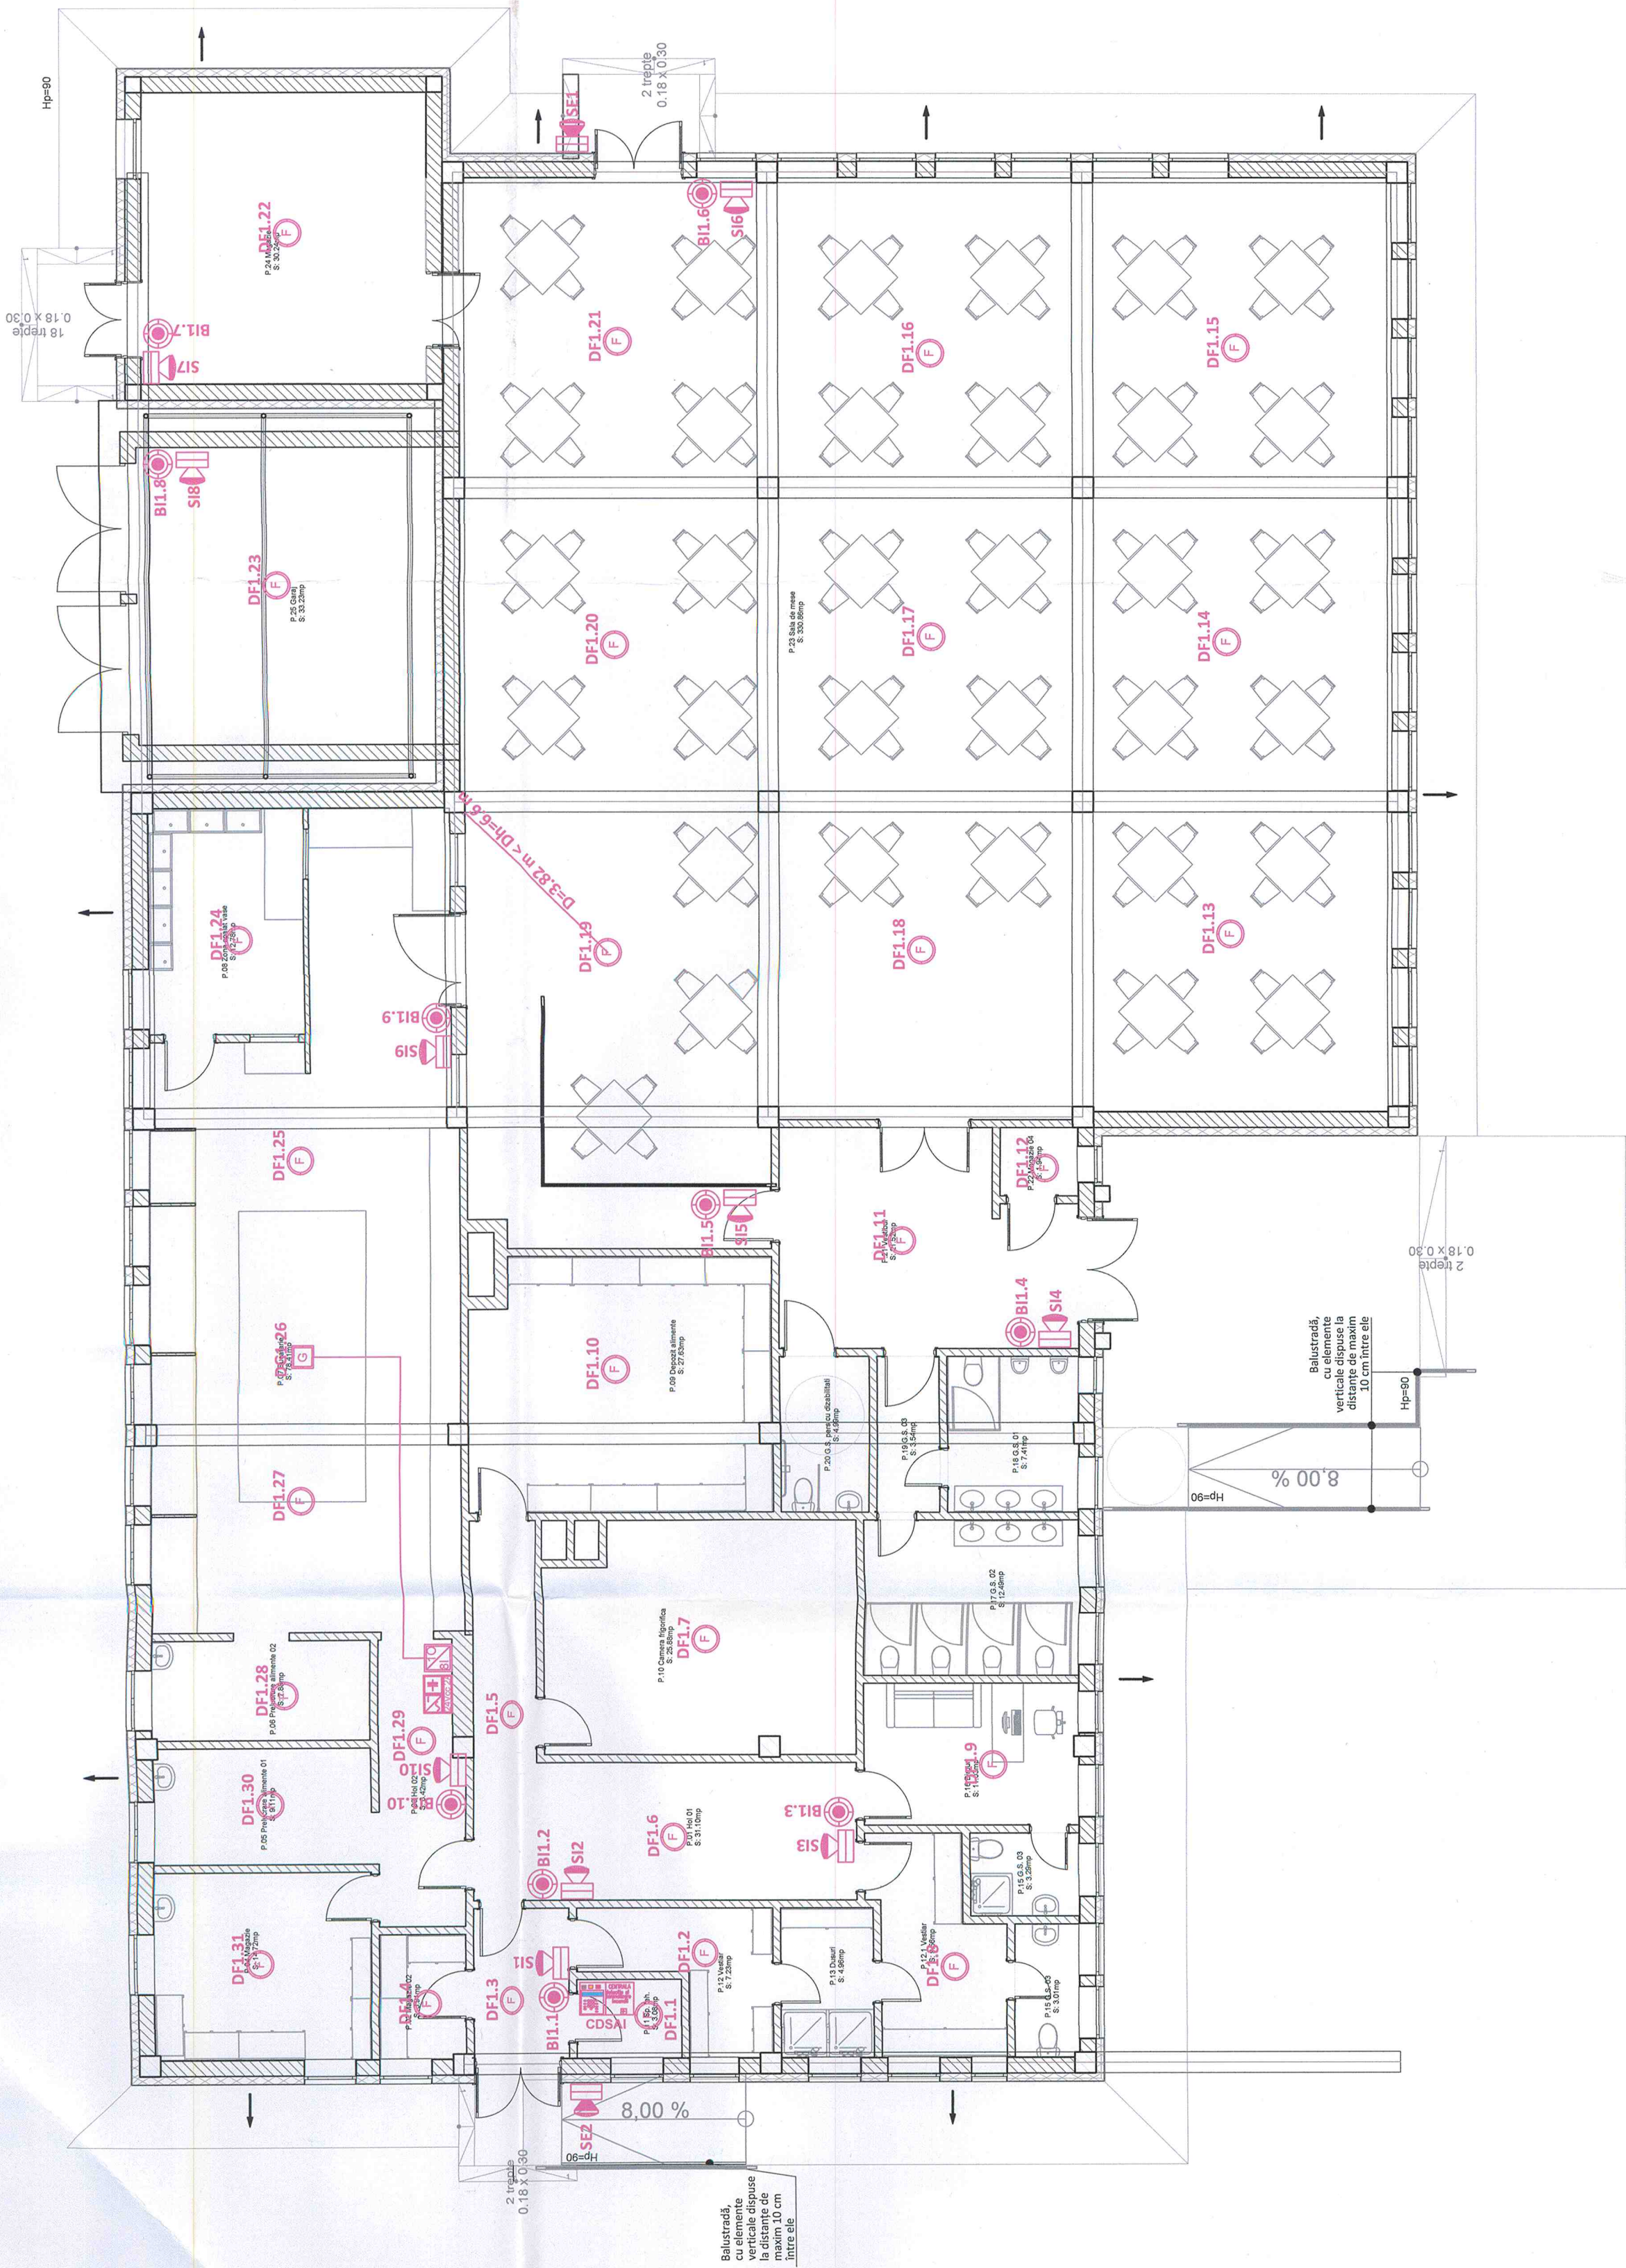

LEGENDA :

	Centrala adresabila de incendiu
	Buton de incendiu adresabil
	Detector optic de fum adresabil
	Detector conventional de gaz, cu buzzer, alimentare 24Vcc, senzor catalitic, alarma prin reu 250Vca, 8A, 24Vcc, IP42
	Sirena de incendiu, montata in interior, adresabila
	Sirena de incendiu, montata in exterior
	Interfaa adresabila input/output, 8 intrari monitorizare 24Vcc si o iesire pe reu NO, 24Vcc, 700mA, izolator de bucla incorporat, tensiune 15-33Vcc, consum 5.5mA din bucla, posibilitate din sursa externa, indicator alarma si stare prin LED, conform EN54
	Sursa de alimentare cu modul de incarcare baterii, iesire maxim 2 * 0.8A, tensiune intrare 230Vca, acumulator de 24V, 7Ah - C1, conform cu EN54-4, cu doua iesiri ce reu pentru alarma si avarie

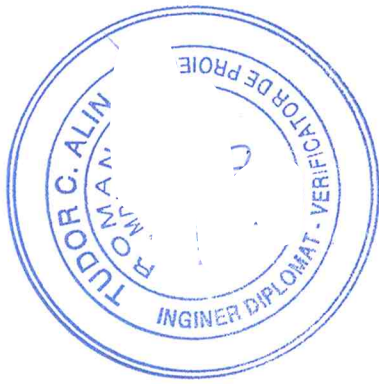

	BENEFICIAR UAT MUNICIPIUL ARAD		PROIECT NR. 689.2024
	DENUMIRE PROIECT AMENAJARE CAMPUS PREUNIVERSITAR TEHNOLOGIC		FAZA D.T.A.C. / P.Th. rev. 00
Rheinbrücke SRL Calea Timisoara Nr. 7 Timisoara 300083 - Romania Coordonate Fiscale RO26555533 J19900002026354 www.rheinbrucke.ro office@rheinbrucke.ro T +40 23 140 12 14	SCARA 1:100		AMPLASAMENT STR. IOAN FLUIERAS Nr. 10C, MUNICIPIUL ARAD, IUD. ARAD CF nr. 363226, TOP nr. 363226
SPECIFICATIE		DATA 07/2025	DENUMIRE PLANSA PLAN PĂRTER CORP C3 CANTINA
Set Protect			
Proiectat			
Proiectat			
Desenat			