



CDSAI-Corp C4 Internat
- parter Sala profesorală -

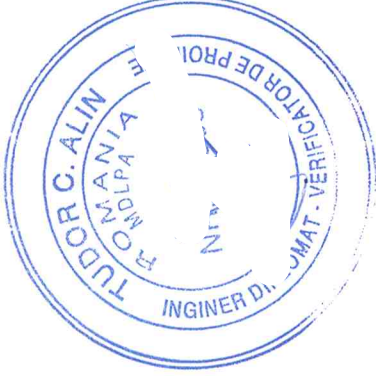

LEGENDA :

	Centrala adresabila de incendiu
	Buton de incendiu adresabil
	Detector optic de fum adresabil
	Detector conventional de gaz, cu buzzer, alimentare 24Vcc, siren catalitic, alarma prin reau 230Vca, SA, 24Vcc, IP42
	Sirena de incendiu, montata in interior, adresabila
	Sirena de incendiu, montata in exterior
	Interfaa adresabila input/output, 8 intrari monitorizate 24Vcc si o iesire pe reau NO, 24Vcc, 700mA, izolator electric incorporat, alimentare 15-30Vcc, consum 5-50mA, montat pe perete, indicator de stare prin LED, conform EN54
	Sursa de alimentare cu modul de incarcare baterii, acumulator 2 x 4Ah, tensiune initare 230Vca, alimentare 24Vcc, autonomie de lucru 24h, acumulator de 24V - 7Ah - C1 conform cu EN54-4, cu doua iesiri de reau pentru alarma si avarie
	Modul 4 intrari/4 iesiri
	Cablu incendiu JY(SiY) E90 2x2x0.8mm

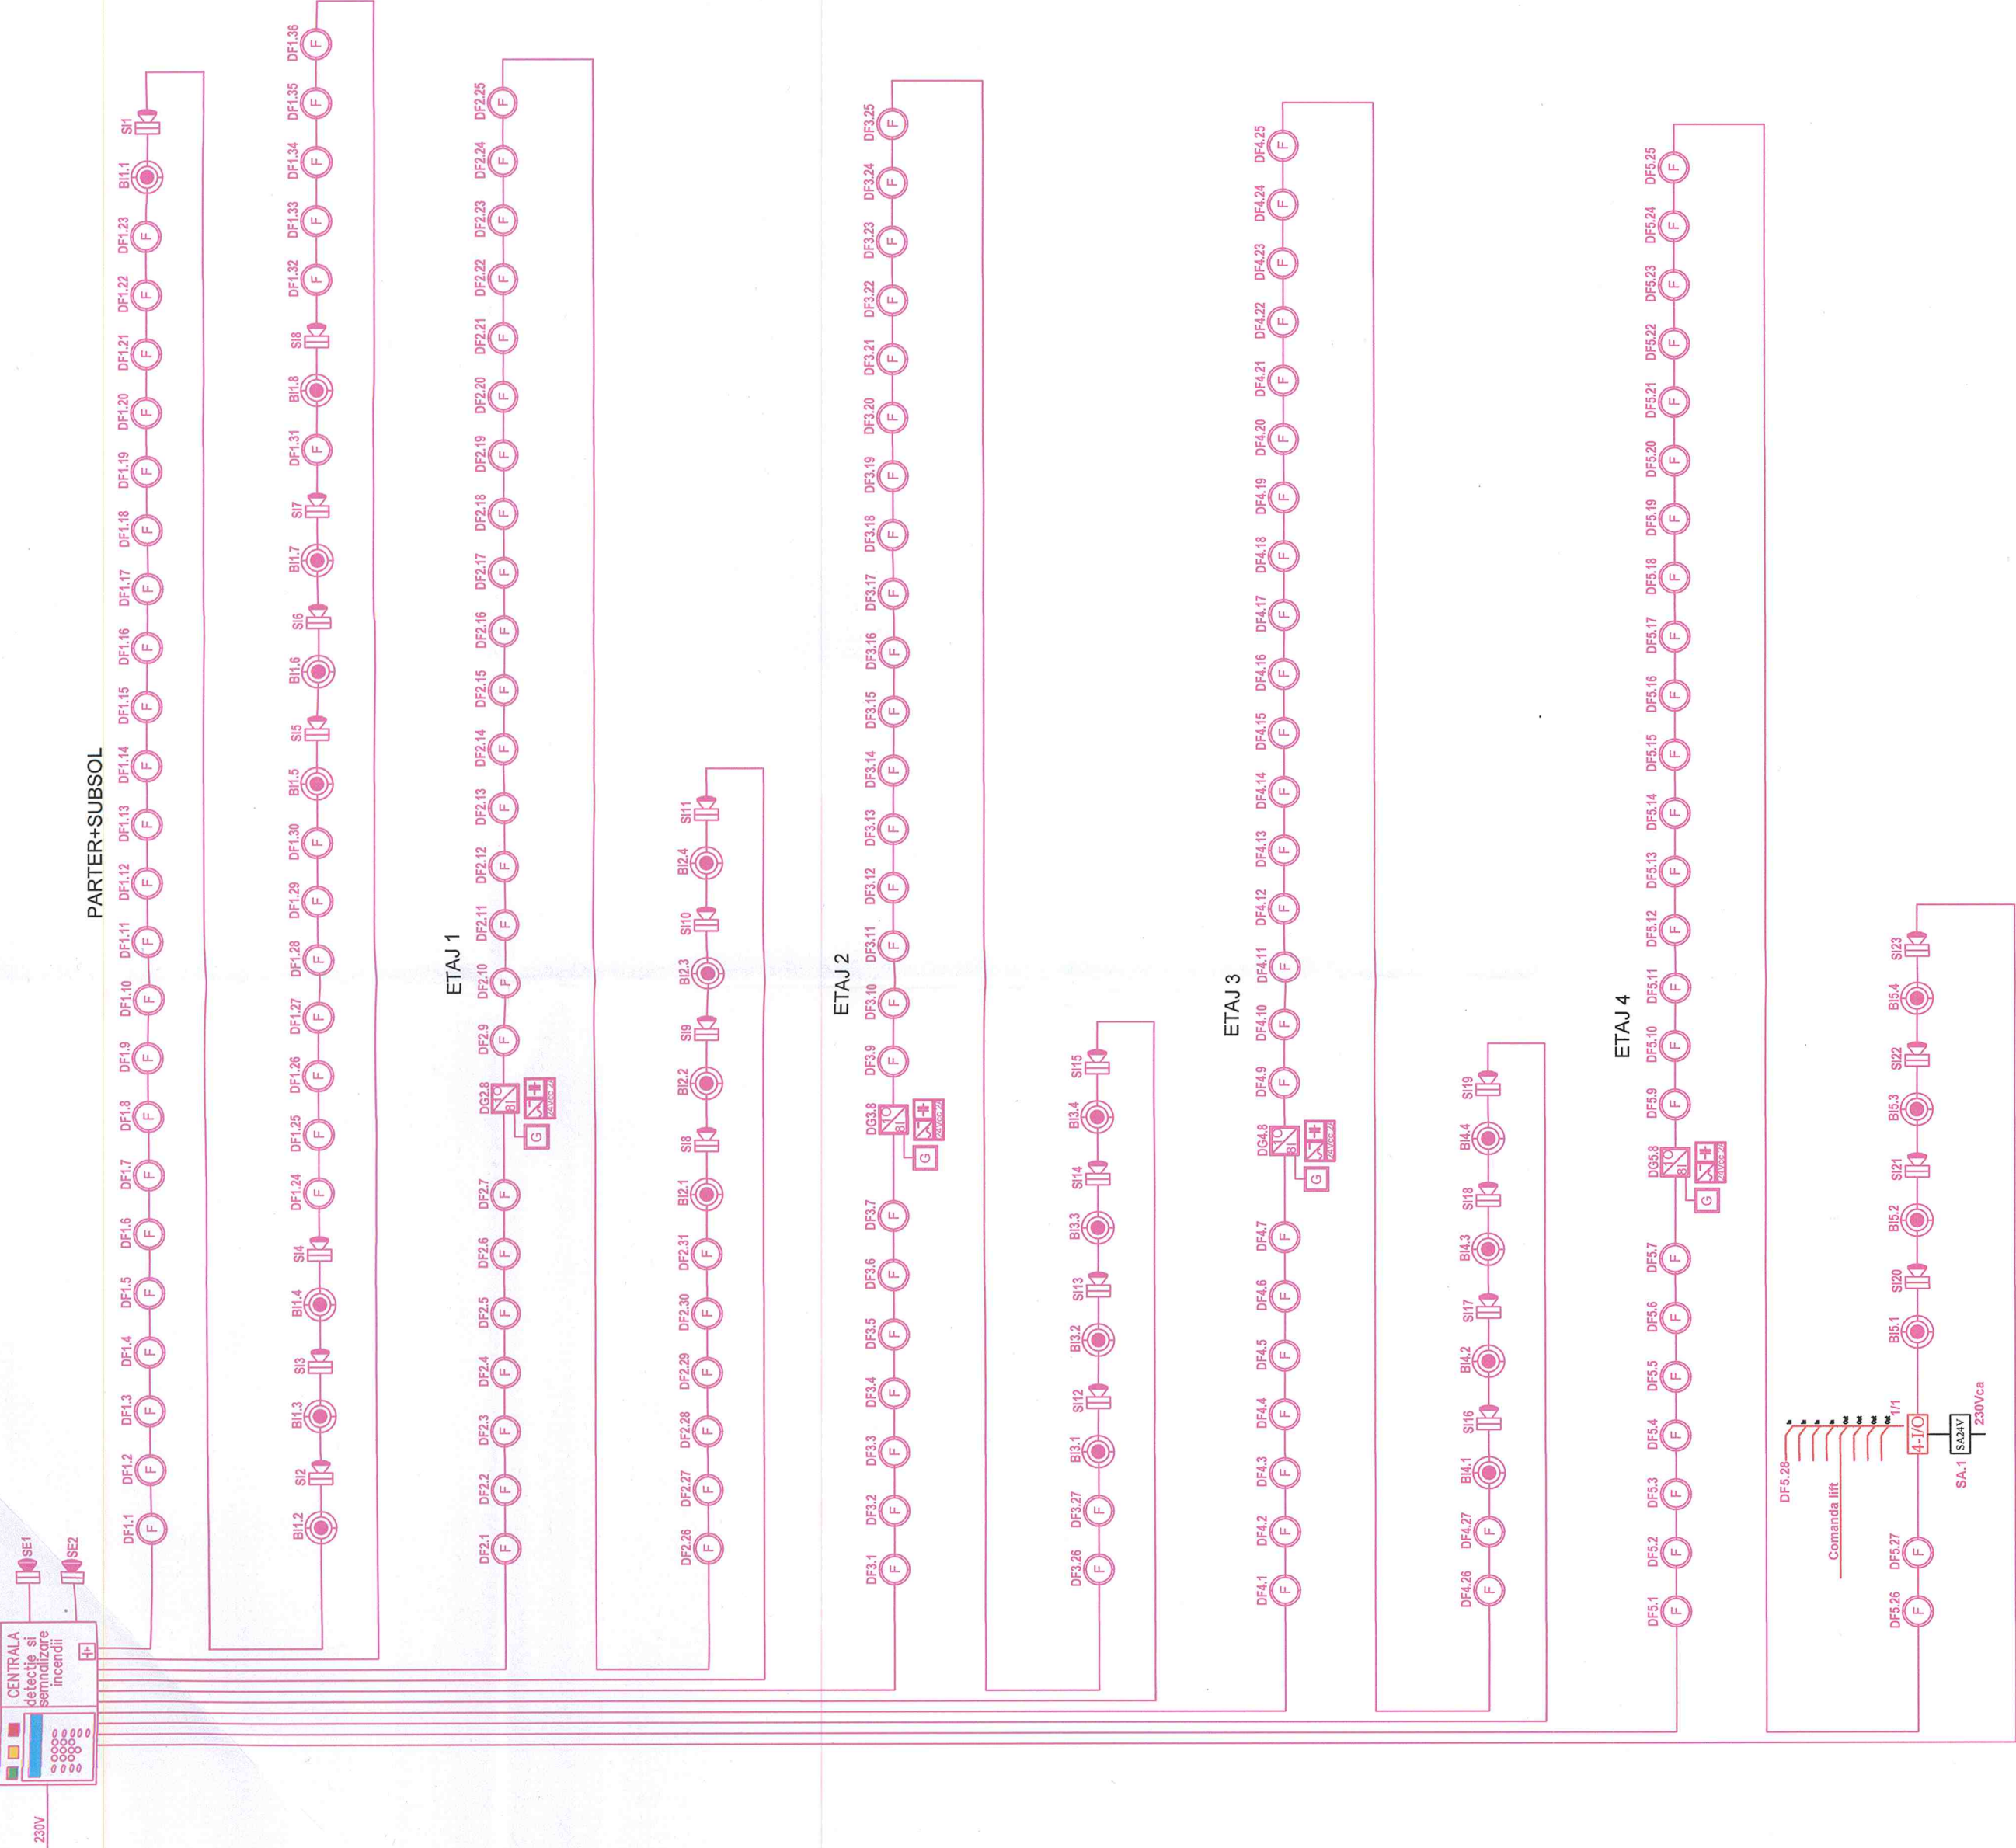

	BENEFICIAR UAT MUNICIPIUL ARAD		PROJECT NR. 699_2024
	DENUMIRE PROIECT AMENAJARE CAMPUS PREUNIVERSITAR TEHNOLOGIC		FAZA D.T.A.C. / P.T.H. rev. 00
SPREZIFICATIE Şef Proiect Proiectat Desenat	NUME arn.HAMZA Augustin Răzvan ing. Gurza Vlad ing. Bulzan Doru ing. Bobes-Ilici Cosmin	SCARA 1:100 DATA 07/2025	AMPLASAMENT STR. IOAN FLUIERAS Nr. 10C, MUNICIPIUL ARAD, JUDE. ARAD CF nr. 363226, TOP nr. 363226 DENUMIRE PLANŞĂ SCHEMA BLOC INCENDIU CORP C4 - INTERNAT COD PLANŞĂ: 12-JDSA