

TEE1

PI=123,50 kW
Ku=0,7
Pmsa=86,45 kW

1	10/0,03A 1P+N	Iluminat evacuare N2XH 3x1,5	1,0/0,7 kW	14	25/0,03A 1P+N	Tablou camer 12 etaj 1 N2XH3x4	6,5/3,9 kW	28	16/0,03A 1P+N	Circuit 2 Ventilocolectoare N2XH3x2,5	2,5/1,75 kW
2	10/0,03A 1P+N	Iluminat panica N2XH 3x1,5	1,0/0,7 kW	15	25/0,03A 1P+N	Tablou camer 13 etaj 1 N2XH3x4	6,5/3,9 kW	29	16/0,03A 1P+N	Circuit 3 Ventilocolectoare N2XH3x2,5	2,5/1,75 kW
Acumulatori				16	25/0,03A 1P+N	Tablou camer 14 etaj 1 N2XH3x4	6,5/3,9 kW	30	16/0,03A 1P+N	Circuit 4 Ventilocolectoare N2XH3x2,5	2,5/1,75 kW
3	25/0,03A 1P+N	Tablou camer 1 etaj 1 N2XH3x4	6,5/3,9 kW	17	10/0,03A 1P+N	Iluminat 1 etaj 1 N2XH3x1,5	1,0/0,7 kW	31	16/0,03A 1P+N	Circuit 5 Ventilocolectoare N2XH3x2,5	2,5/1,75 kW
4	25/0,03A 1P+N	Tablou camer 2 etaj 1 N2XH3x4	6,5/3,9 kW	18	10/0,03A 1P+N	Iluminat 2 etaj 1 N2XH3x1,5	1,0/0,7 kW				
5	25/0,03A 1P+N	Tablou camer 3 etaj 1 N2XH3x4	6,5/3,9 kW	19	16/0,03A 1P+N	Prize 1 etaj 1 N2XH3x2,5	2,0/1,4 kW				
6	25/0,03A 1P+N	Tablou camer 4 etaj 1 N2XH3x4	6,5/3,9 kW	20	16/0,03A 1P+N	Prize 2 etaj 1 N2XH3x2,5	2,0/1,4 kW				
7	25/0,03A 1P+N	Tablou camer 5 etaj 1 N2XH3x4	6,5/3,9 kW	21	16/0,03A 1P+N	Prize 1 oficiu N2XH3x2,5	2,0/1,4 kW				
8	25/0,03A 1P+N	Tablou camer 6 etaj 1 N2XH3x4	6,5/3,9 kW	22	16/0,03A 1P+N	Prize 2 oficiu N2XH3x2,5	2,0/1,4 kW				
9	25/0,03A 1P+N	Tablou camer 7 etaj 1 N2XH3x4	6,5/3,9 kW	23	16/0,03A 1P+N	Frigider N2XH3x2,5	2,0/1,4 kW				
10	25/0,03A 1P+N	Tablou camer 8 etaj 1 N2XH3x4	6,5/3,9 kW	24	25/0,03A 1P+N	Pila N2XH3x4	2,0/1,4 kW				
11	25/0,03A 1P+N	Tablou camer 9 etaj 1 N2XH3x4	6,5/3,9 kW	25	25/0,03A 1P+N	Cuptor N2XH3x4	2,0/1,4 kW				
12	25/0,03A 1P+N	Tablou camer 10 etaj 1 N2XH3x4	6,5/3,9 kW	26	16/0,03A 1P+N	MSV N2XH3x2,5	2,0/1,4 kW				
13	25/0,03A 1P+N	Tablou camer 11 etaj 1 N2XH3x4	6,5/3,9 kW	27	16/0,03A 1P+N	Circuit 1 Ventilocolectoare N2XH3x2,5	2,5/1,75 kW				

De la TG

160A

NHXH 3x95+50

3P+N




3F-NL-PE 380/400V-50Hz

TEE1: Tablou electric etaj 1 Internat TEE1

Toate materialele vor avea agrement tehnic si certificat de calitate. Lucrarile se executa de catre electricieni autorizati cu respectarea normativelor in vigoare I7, NTE007/2008 si Normelor specifice de securitate, sanatare in munca si pentru situatii de urgenta PSI in vigoare.

Tabloul se va executa in carcasa din polycarbonat, va avea bare de nul de lucru si nul de protectie, va fi dotat cu sonerie modulara. Disjunctoarele vor avea capacitate de rupere min. 6 kA.

 RHEIN BRUCKE		Rheinbrücke SRL Eugeniu de Savoy Nr.7 Timisoara 300065 - Romania Coordonata Fiscala RO 2806383 J1993000028384 www.rheinbruecke.ro office@rheinbruecke.ro T +40 729 142 599	
SPECIFICATIE	NUME	SEMANTICA	
Seif Proiect	ing. HANZA Augustin Răzvan		
Proiectat	ing. Nistor Paul		
Proiectat	ing. Bulzan Doru		
Desenat	ing. Bobes-Ilici Cosmin		
BENEFICIAR UAT MUNICIPIUL ARAD		PROIECT NR. 699_2024	
DENUMIRE PROIECT AMENAJARE CAMPUS PREUNIVERSITAR TEHNOLOGIC		FAZA D.T.A.C./P.Th. rev. 00	
SCARA 1:100		AMPLASAMENT STR. IOAN FLUJERAS Nr. 10C, MUNICIPIUL ARAD, JU.D. ARAD CF nr. 363226, TOP nr. 363226	
DATA 07/2025		DENUMIRE PLANSA SCHEMA TABLOU ELECTRIC ETAJ 1 INTERNAT - TEE1 COD PLANSA: 34-IE	

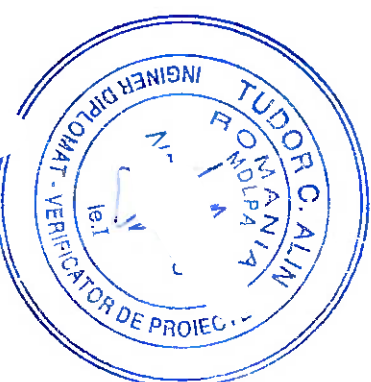

INGINIER DIPLOMAT - VERIFICATOR DE PROIECT

TUDOR C. ALIN

ROMANIA

le.1



RHEIN BRUCKE SRL

363 : J367 9/1893

TIMISOARA - ROMANIA