


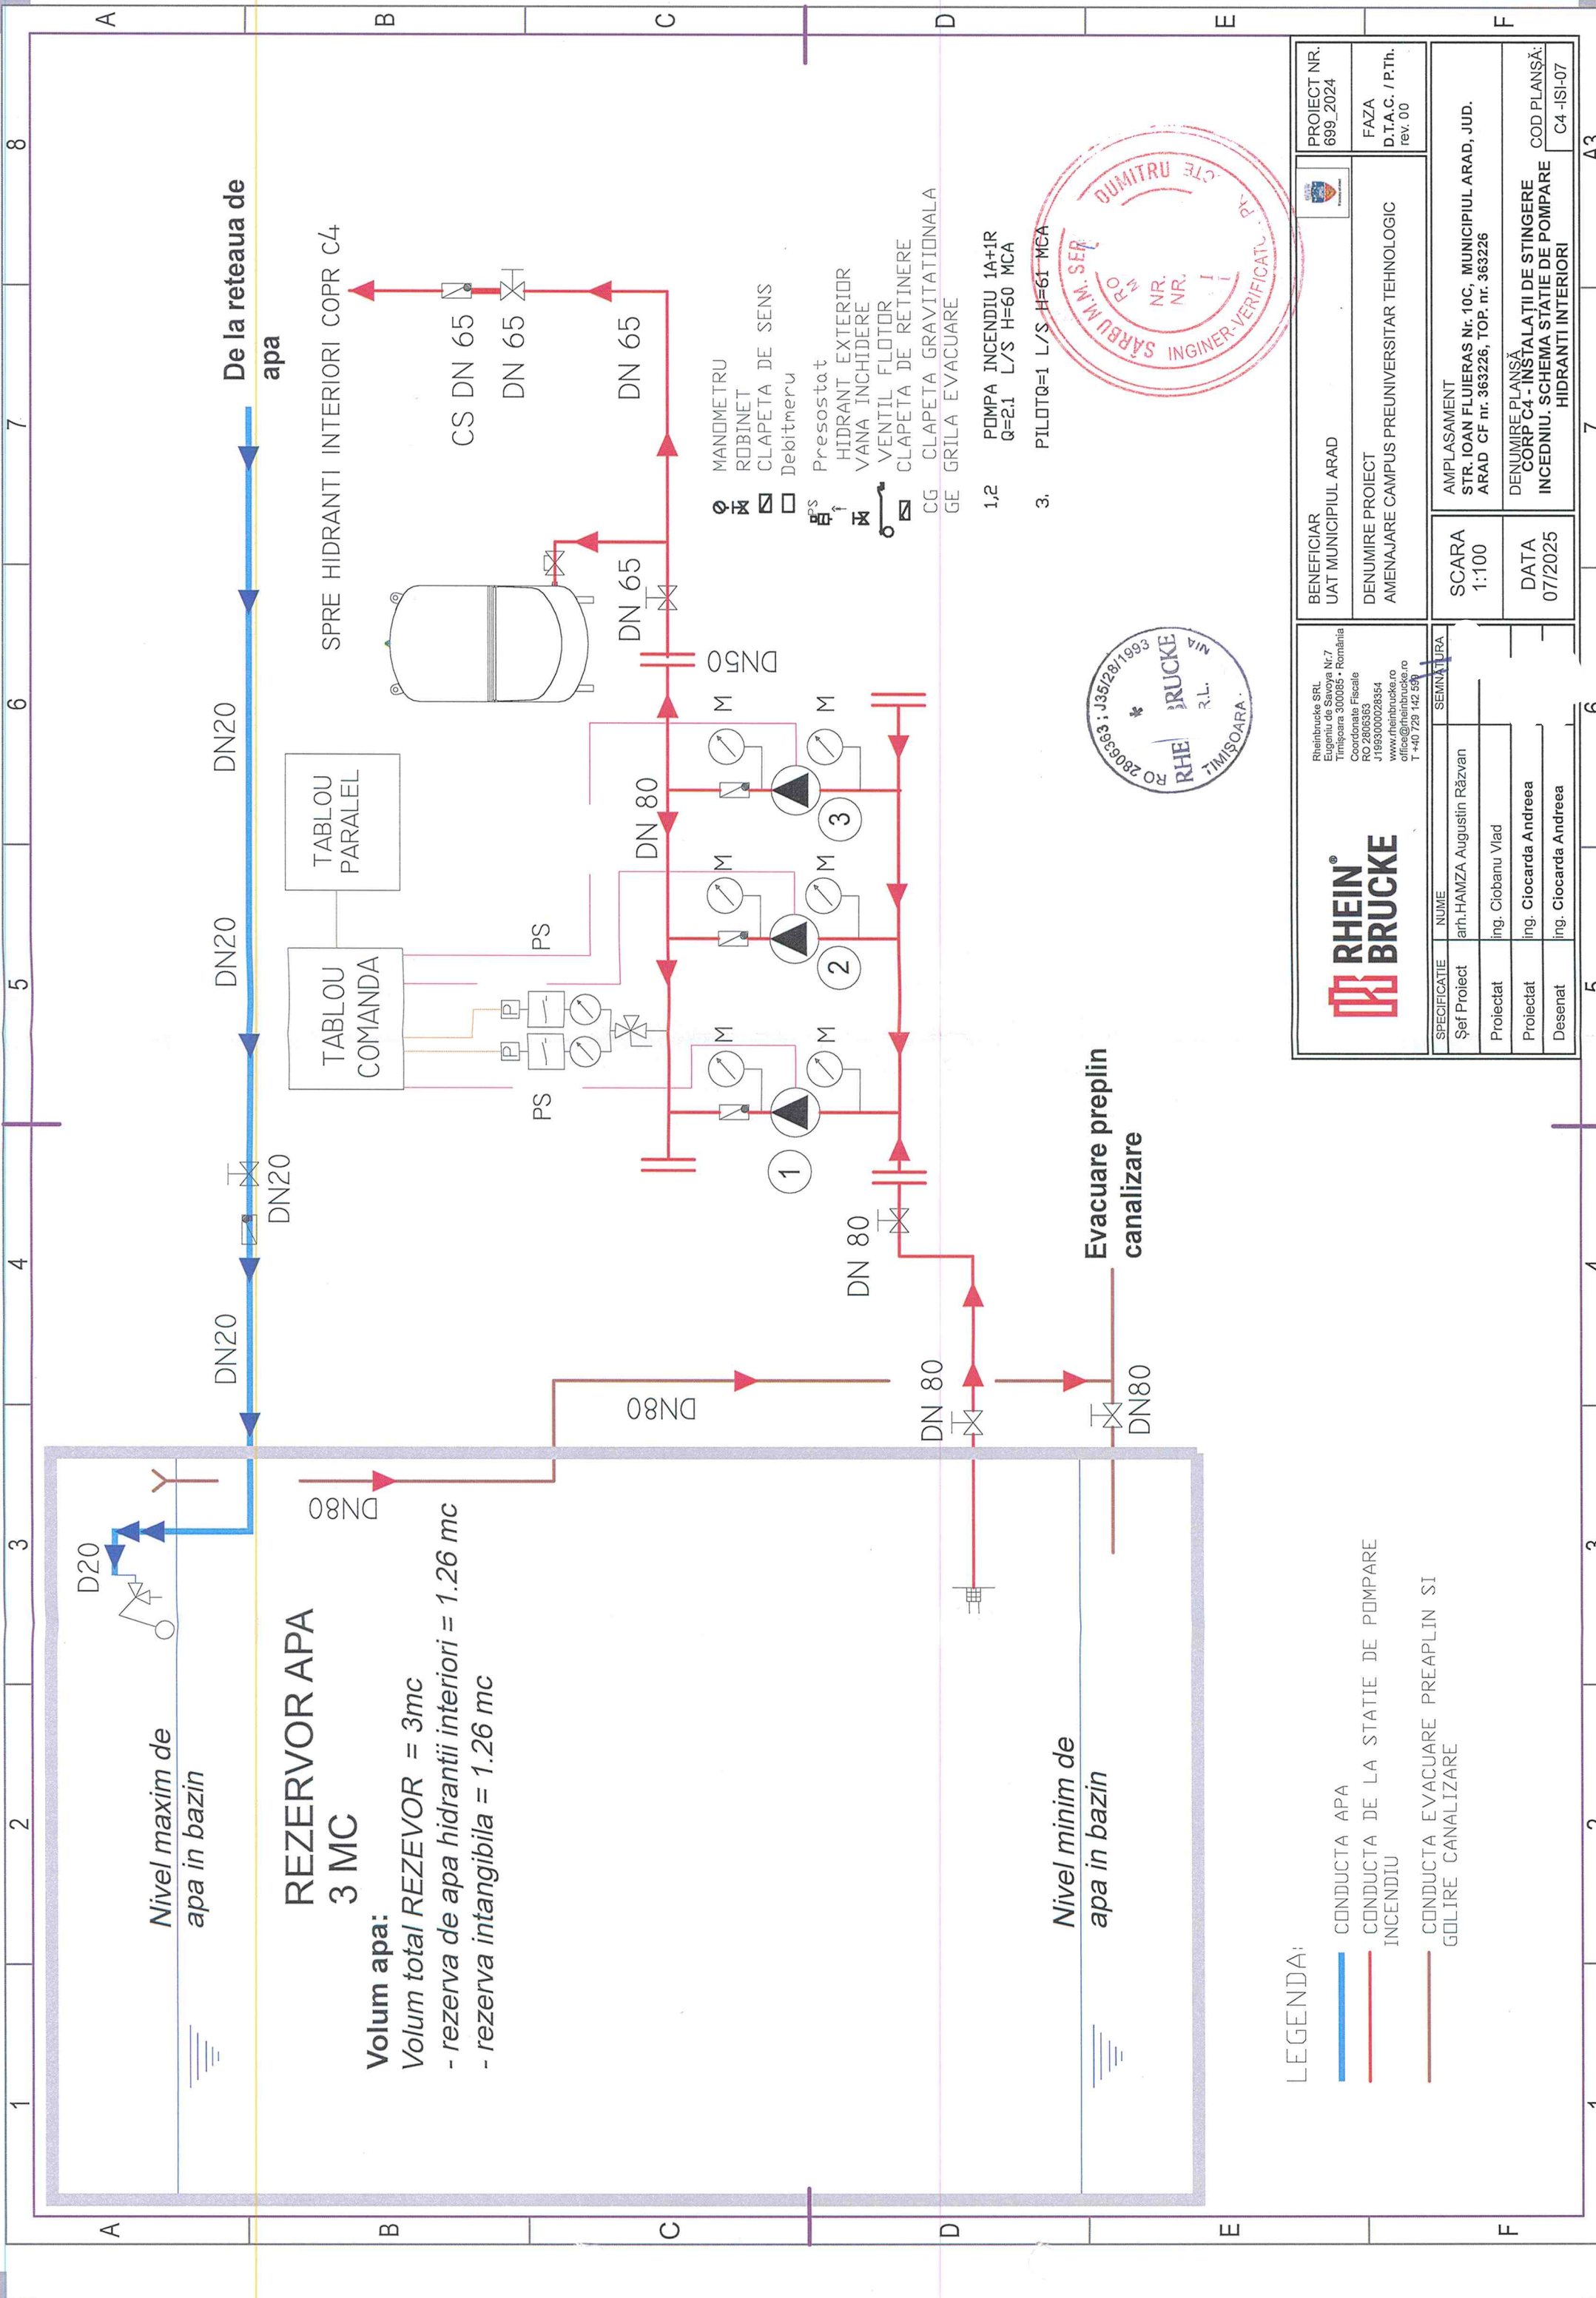

REZERVOR APA
3 MC

Volum apa:
Volum total REZERVOR = 3mc
- rezerva de apa hidrantii interiori = 1.26 mc
- rezerva intangibila = 1.26 mc

Nivel maxim de
apa in bazin

Nivel minim de
apa in bazin


LEGENDA:

- CONDUCTA APA
- CONDUCTA DE LA STATIE DE POMPARE INCENDIU
- CONDUCTA EVACUARE PREAPLIN SI GOLIRE CANALIZARE



RHEINBRÜCKE

Rheinbrücke SRL
Eugeniu de Savoyă Nr.7
Timișoara 300085 • România
Coordonate Fiscale
RO 2806363
J1199300028354
www.rheinbruecke.ro
office@rheinbruecke.ro
T +40 729 142 599

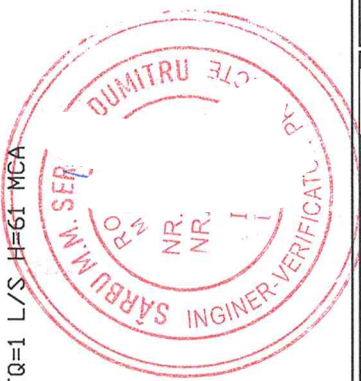

BENEFICIAR UAT MUNICIPIUL ARAD		PROIECT NR. 699_2024
DENUMIRE PROIECT AMENAJARE CAMPUS PREUNIVERSITAR TEHNOLOGIC		FAZA D.T.A.C. / P.Th. rev. 00
SCARA 1:100	AMPLASAMENT STR. IOAN FLUIERAS Nr. 10C, MUNICIPIUL ARAD, JUD. ARAD CF nr. 363226, TOP. nr. 363226	COD PLANȘĂ: C4 - ISI-07
DATA 07/2025	DENUMIRE PLANȘĂ CORP C4 - INSTALAȚII DE STINGERE INCENDIU, SCHEMA STĂTIE DE POMPARE HIDRANTI INTERIORI	