
Digitally signed by ISU Arad
Date: 2026.09.03 12:21:44
EEST

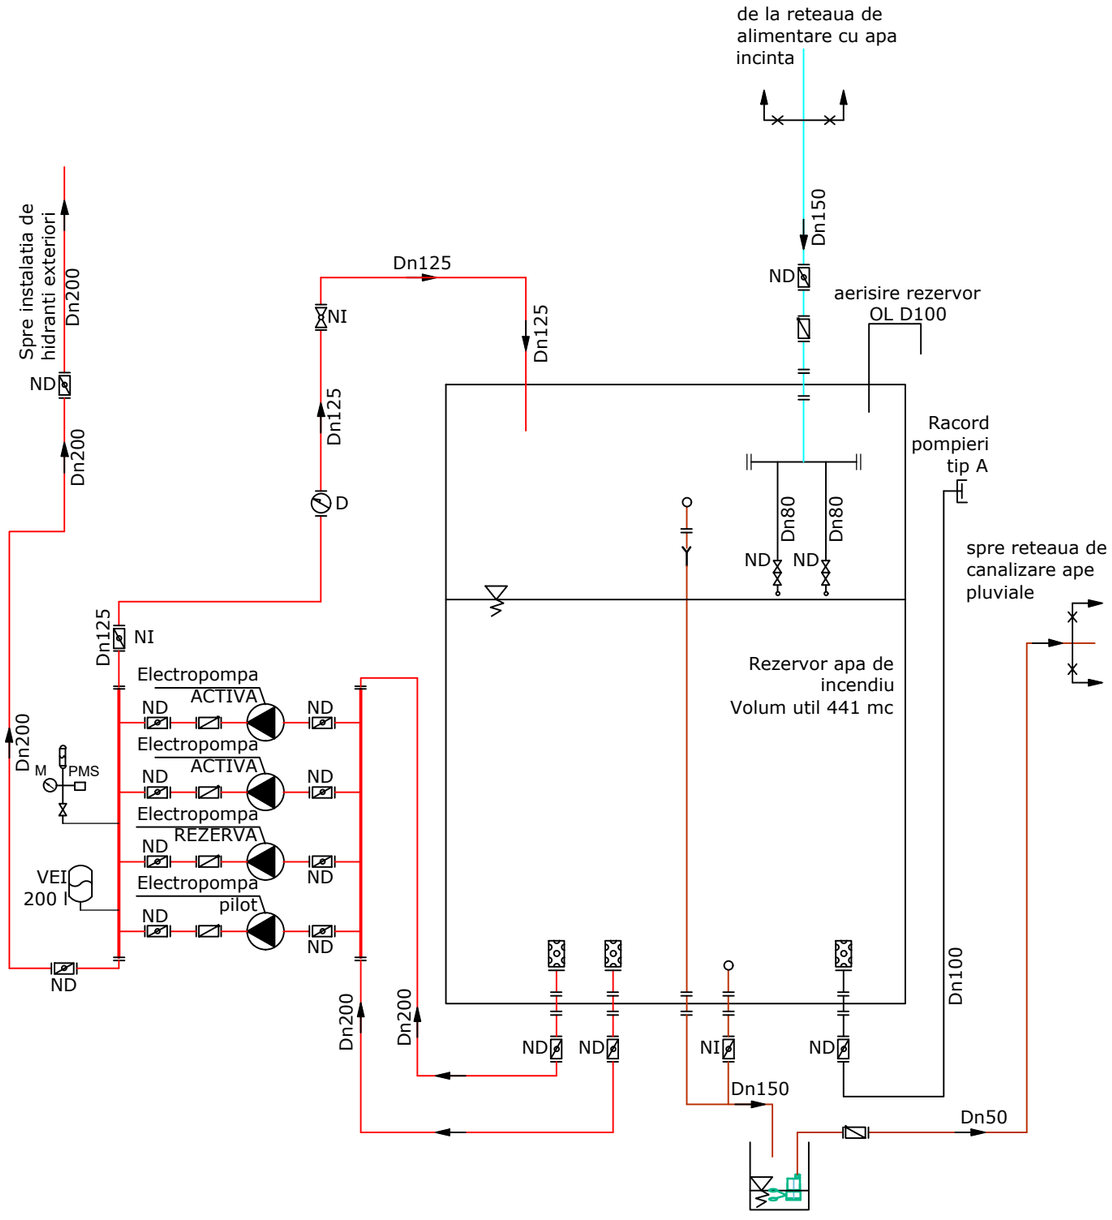

LEGENDA

	Conducta de alimentare hidranti
	Conducta de alimentare cu apa rece
	Conducta de golire preaplin
	Vane fluture
	Vane cu sertar
	Sorb cu flanse
	Clapeta de retinere
VEI 200 l	Vas de expansiune inchis PN10 V=200 l
PMS	Senzor de presiune
M	Manometru
Rg1"	Robinet de golire
	Robinet cu sertar si robinet cu plutitor
ND / NI	Pozitie vana ND-normal deschis, NI-normal inchis
Dhdr D200	Distribuitor hidranti, amplasat in Statia de Pompare
	Grup de pompare Hidranti Exteriori, 2 Active+1 Rezerva+1pilo
	Q=30 l/s, H=60 mCA, Pel abs=30 kW, alim. 50Hz/400V
	Pompa de basa cu comanda plutitor
	Debitmetru Dn125mm, Qn=90 mc/h

Stefan Duna — Semnat digital de Stefan Duna Data: 2026.08.18 16:50:55 +03'00'

Adrian-George Madar — Digitally signed by Adrian-George Madar Date: 2026.08.18 15:14:37 +03'00'

POPESCU CIPRIAN-MARIAN — Digitally signed by POPESCU CIPRIAN-MARIAN Date: 2026.08.18 11:08:30 +03'00'

VERIFICATOR			I.S.	REFERAT NR.:
VERIFICATOR/ EXPERT	NUME	SEMNĂTURA	CERINŢA	REFERAT/EXPERTIZĂ Nr./DATA
PROIECTANT: **SC MADI FHVAC SRL** www.madifhvac.ro J02/346/2008; RO23355185				Beneficiar: **MUNICIPIUL ARAD** **mun. Arad, b-dul Revolutiei, nr. 75, jud. Arad** — Nr. pr. 338-06.2026
SPECIFICAŢIE	NUME	SEMNĂTURA	Scara: %	Titlu proiect: **REABILITARE STATIE DE POMPE DE GOSPODARIREA APELOR ZONA INDUSTRIALA SUD** — Faza DALI + DTAC
ŞEF PROIECT:	arh. Ciprian Popescu		Data: 06.2026	Titlu planşă: SCHEMA FUNCTIONALA A INSTALATIEI DE HIDRANTI EXTERIORI — Nr. pl: IH02
PROIECTAT:	ing.Adrian Madar			
DESENAT:	ing.Adrian Madar			